


GEKO SERIES GKV225/GKV225G

2 PIECE FLANGED FULL PORT BALL VALVES

Installation, Operation, and Maintenance Manual

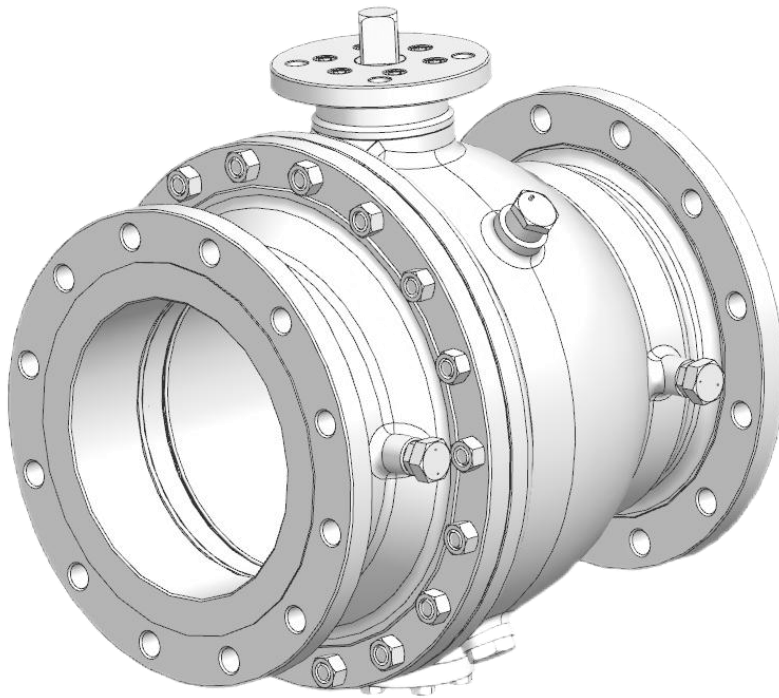

GEKO
CONTROL-VALVES

CONTENTS

DEFINITION OF TERMS

INTRODUCTION

PARTS IDENTIFICATION

SECTION VIEWS

GENERAL INFORMATION FOR ON-SITE INSTALLATION

SAFETY TIPS AND WARNINGS.

SHORT AND LONG-TERM STORAGE

OPERATION

STEM SEAL ADJUSTMENT

BALL SUPPORT PACKING ADJUSTMENT

DISASSEMBLY AND CLEANING PROCEDURE

DISASSEMBLY FOR STEM AND SEAL REMOVAL

VISUAL INSPECTION

ASSEMBLY

RETURN MERCHANDISE AUTHORIZATION

READ AND FOLLOW THESE INSTRUCTIONS CAREFULLY.
SAVE THIS MANUAL FOR FUTURE USE.

1.0 DEFINITION OF TERMS

All information within this manual is relevant to the safe operation and proper care of your Geko valve. Please understand the following examples of information used throughout this manual.



DANGER

Indicates a potentially hazardous situation which, if not avoided, will result in death or serious injury.



WARNING

Indicates a potentially hazardous situation which, if not avoided, could result in death or serious injury.



CAUTION

Indicates a potentially hazardous situation which, if not avoided, could result in minor or moderate injury.



NOTICE

Used without the safety alert symbol, indicates a potential situation which, if not avoided, may result in an undesirable result or state, including property damage.

2.0 INTRODUCTION

The design features of this valve include a split body, two piece construction, allowing ease of maintenance without special tools. These valves feature a “free floating” ball. The ball is not fixed, but is free to move with the line pressure.

As a result of this feature, these valves are capable of tight shut-off with flow in either direction or dead-ended, regardless of the position of the valve in the line.

The downstream seat, opposite the pressurized side of a closed valve, must carry the load exerted by the line pressure on the ball, while the upstream seat is subject to little load or wear. For this reason, it is sometimes possible to increase useful seat life by turning the valve end-for-end in the pipeline.

GEKO SERIES GKV225/GKV225G

2 PIECE FLANGED FULL PORT BALL VALVES

Installation, Operation, and Maintenance Manual


3.0 PARTS IDENTIFICATION

ITEM NAME

½" – 12" Valves


© 2023 GEKO VALVES&CONTROLS. ALL RIGHTS RESERVED. GEKO-UNONM.COM The Information contained herein shall not be copied, transferred, conveyed, or displayed in any manner that would violate its proprietare without the express written permission of Geko Valves&Controls.

5 of 20

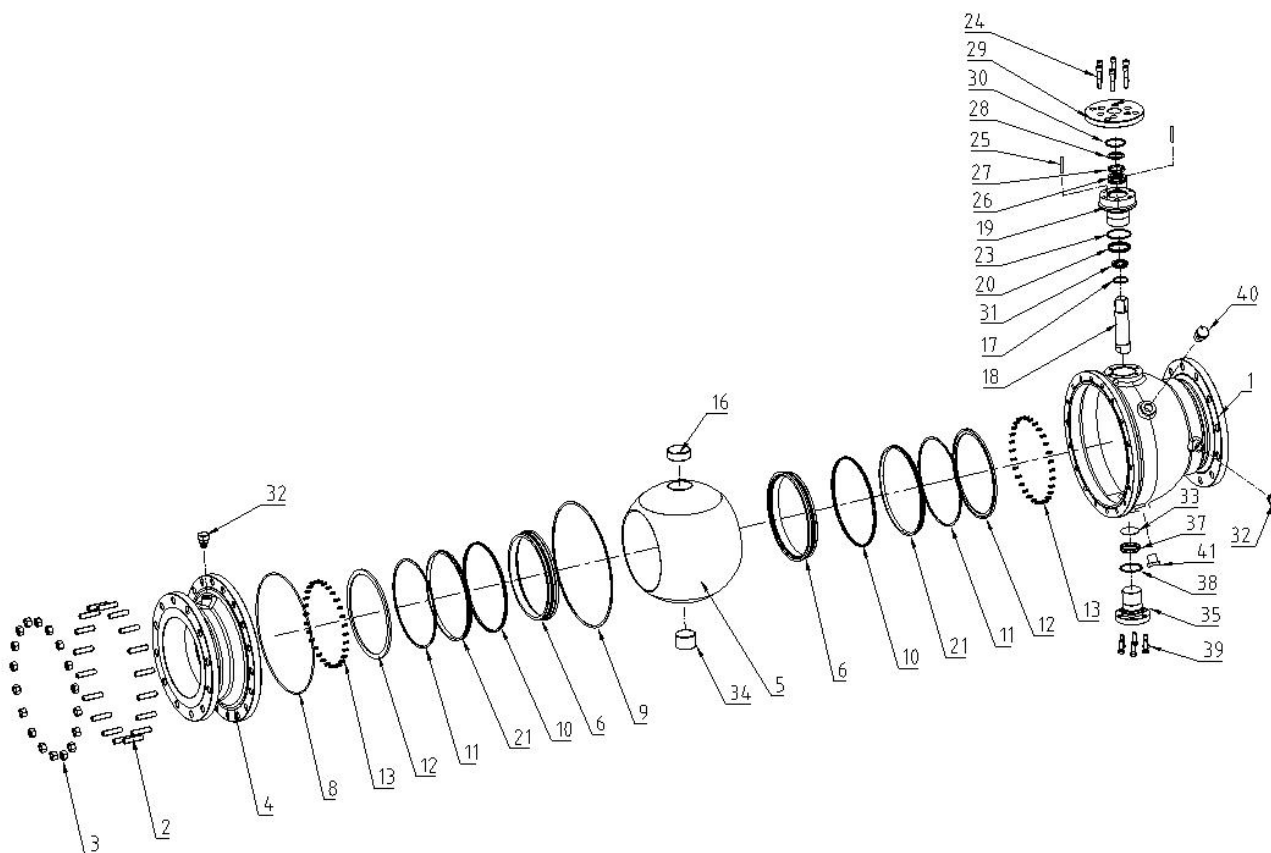

21	retainer	41	air evacuation valve
20	O-ring (outside the packing box)	40	admission valve
19	stuffing box	39	External hexagon bolt
18	valve stem	38	Seal ket (lower stem)
17	flakelet	37	O-ring (lower valve stem)
16	upper bearing	35	Lower valve rod
13	compression spring	34	lower bearing
12	Valve seat pressure coil	33	bed down the livestock
11	Fire gasket	32	Injection fat valve
10	Energy storage circle	31	O-ring (in the packing box)
9	Big thin piece	30	Gasket (top flange)
8	O molding ring	29	The top flange
6	valve seat	28	Disc type huasi
5	steel ball	27	siderosphere
4	Deputy valve body	26	filling
3	Valve nut	25	stationary pin
2	Valve body bolt	24	inside hexagonal bolt
1	Main valve body	23	Seal ket (packing box)
order number	Part name	order number	Part name

4.0 SECTION VIEWS

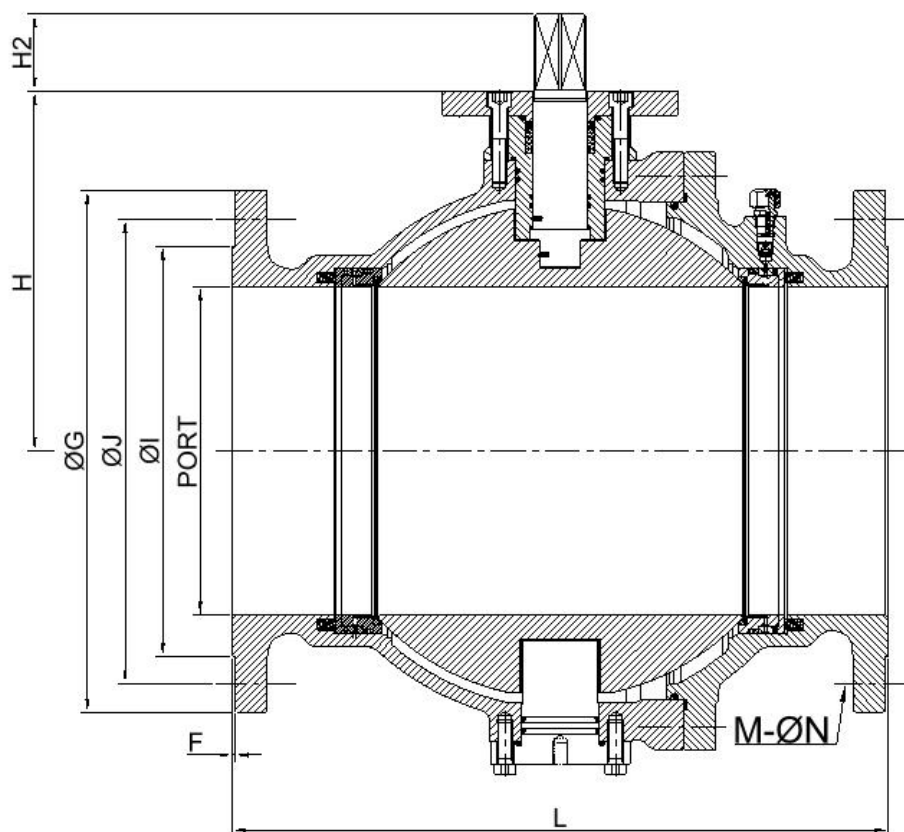

SECTION VIEW 5" - 12" VALVES

Dimensions may be found in product literature.

5.0 GENERAL INFORMATION FOR ON-SITE INSTALLATION

The valve may be installed in any orientation on the pipeline and should be installed in the full open position

Before installing the valves, the pipes must be flushed clean of dirt, burrs, and welding residues, or the seats and ball surface will be damaged. If for any reason the valve is installed prior to flushing of the piping system, the valve must remain in the full open position until the piping system has been fully flushed clean of debris.

For hydrostatic testing of the piping system, the valves must be placed in the half open position prior to pressurizing the system. If the valve is installed in a dead-end position on the piping, the valve must be placed in the half open position and equipped with a blind flange prior to pressurizing the system.



NOTICE

Hydrostatic system testing with the valve in the closed position may result in damage to the valve seats, affecting their ability to create a proper seal. Failure to implement the installation and testing instructions as outlined, resulting in a valve failure, will void the warranty coverage of the product.

5.1 Use

The valve should be maintained as part of a preventative maintenance program and in accordance with manufacturer's recommended pressure, temperature and corrosion limits to insure a long service life. During shipment, storage, and in operation, the valve should be fully open or fully closed ("open" is preferred for shipping and storage). Do not use in throttling service without investigating flow and pressure conditions.



WARNING

Before installing this equipment, confirm that it is suitable for the intended service.

The identification tags describe the maximum allowable service conditions for this product.

Be sure that the installation is protected by appropriate pressure control and safety devices to insure that acceptable limits are not exceeded.

6.0 SAFETY TIPS AND WARNINGS

1. Before installation confirm that valve is suitable for the intended service.
2. Make sure that line is depressurized and drains are open/monitored during installation.
3. Before working on valve being in service make sure that service media has been flushed and line is safe. Make sure that all applicable MSDS sheets are available. Follow all safety related procedures.
4. Before disassembly valve shall be cycled several times to assure there is no pressure trapped in body cavity.
5. During assembly make sure that all threaded connections are safe and have proper engagement.
6. During the pressure test of reassembled valve follow all safety precautions to avoid possible injury. (Use of proper test equipment, correct parts assemblies, follow test procedures.)
7. While line is under pressure DO NOT remove packing gland or any other valve parts.

7.0 SHORT AND LONG-TERM STORAGE

7.1 Short-Term Storage

Short-term storage is defined as storage of products and equipment to be used in the construction of a project for periods of one to three months. Short-term storage must be carried out in a controlled manner as follows:

1. Valves must be stored in a closed, clean, and dry environment.
2. Ball valves should be stored in the fully open position to protect the ball and seats.
3. Ball valves should remain in the original shipping container and be placed on pallets of wood or other suitable materials. End protectors should remain on the valve ends to prevent the entrance of dirt, and removed only at time of installation.

7.2 Long-Term Storage

Long-term storage is defined as storage of products and/or equipment for periods longer than 3 months. Long-term storage must be carried out in a controlled manner as follows:

1. Valves must be stored in a closed, clean, and dry environment.
2. Ball valves should be stored in the fully open position to protect the ball and seats.
3. Ball valves should remain in the original shipping container and be placed on pallets of wood or other suitable materials. End protectors should remain on the valve ends to prevent the entrance of dirt, and removed only at time of installation.
4. Periodically, the valves should be checked to ensure the above conditions are maintained.

These are general guidelines for valve storage. Please consult the factory for information regarding specific requirements.

8.0 OPERATION

Operation of the valve is done by turning the handle a 1/4 turn (90 degree turn). clockwise (CW) to close, counter clockwise (CCW) to open.

8.1 Valve Open Position

The handle is parallel with the pipeline.

8.2 Valve in closed Position

The handle is perpendicular to the pipeline.

Valves with actuators should be checked for actuator -valve alignment. Misalignment will result in high operational torque and damage to valve stem and seals.

9.0 STEM SEAL ADJUSTMENT

Stem seal leakage may be corrected without disassembly by tightening the packing nut / gland bolts until such leakage stops. If the leakage continues or valve operating torque becomes excessive, the seals are worn and replacement will be necessary.

For 1/2"- 2", if slight leakage is noted at stem, straighten lock washer tab, tighten packing nut to flatten Belleville Washers, back packing nut off 1/4 turn, secure lock washer tab. For standard valve trims, see Table 1 for recommended assembly torque values. For Fugitive Emissions or API 608 qualified trims, see Table 3 for recommended assembly torque values.

For sizes larger than 2", simply tighten gland bolts evenly until leak stops. Do not over tighten. For standard valve trims, see Table 2 for recommended assembly torque values. For Fugitive Emissions or API 608 qualified trims, see Table 4 for recommended assembly torque values.



WARNING

DO NOT remove packing gland or any other valve parts while line is under pressure!

Table 1 -Packing Nut Assembly Torque

Valve Size NPS	Recommended Torque lbs-in	Valve Size DN	Recommended Torque N m
1/2	53	15	6
3/4	53	20	6
1	53	25	6
1-1/2	132	40	15
2	132	50	15

Table 2 - Gland Bolt Assembly Torque

Valve Size NPS	Recommended Torque lbs-in	Valve Size DN	Recommended Torque N m
2-1/2	89	65	10
3	89	80	10
4	89	100	10
6	106	150	12
8	106	200	12
10	124	250	14
12	124	300	14

GEKO SERIES GKV225/GKV225G 2 PIECE FLANGED FULL PORT BALL VALVES

Installation, Operation, and Maintenance Manual



Table 3 - Packing Nut Assembly Torque - Fugitive Emissions & API 608 Trim

Valve Size NPS	Recommended Torque (lbs-in)		Valve Size DN	Recommended Torque (N m)	
	Combination Packing	Standard Packing (Graphite, RPTFE)		Combination Packing	Standard Packing (Graphite, RPTFE)
1/2		53	15		6
3/4		53	20		6
1		80	25		9
1-1/2		160	40		18
2		160	50		18

Table 4 - Gland Bolt Assembly Torque - Fugitive Emissions & API 608 Trim

Valve Size NPS	Recommended Torque (lbs-in)		Valve Size DN	Recommended Torque (N m)	
	Combination Packing	Standard Packing (Graphite, RPTFE)		Combination Packing	Standard Packing (Graphite, RPTFE)
2-1/2	200	175	65	22.5	20
3	200	175	80	22.5	20
4	200	175	100	22.5	20
6		360	150		41
8		360	200		41
10	Consult Engineering		250	Consult Engineering	
12	Consult Engineering		300	Consult Engineering	

10.0 DISASSEMBLY AND CLEANING PROCEDURE



CAUTION

Line must be depressurized before disassembly. Valve should be cycled to assure there is no pressure trapped in valve cavity. Ball valves can trap pressurized media when closed. Flush line with valve in the half open position to remove hazardous media.

If the valve has been used to control hazardous media, it must be decontaminated before disassembly.

It is recommended that the following steps be taken for safe removal and assembly.

As shipped from the factory, valves contain silicone based lubricant. This is for break-in and may be removed by disassembly and solvent washing, if it is objectionable for a particular application.

11.0 DISASSEMBLY FOR STEM AND SEAL REMOVAL

Remove flange bolts and nuts and lift valve from line for servicing.

NOTE: Care should be taken to avoid scratching or damaging serrated flange face. These valves are heavy!

They should be adequately supported before removal from the line is begun.

Loosen handle set screw and remove handle and stop plate. Next, remove gland nuts, gland flange and gland.

Remove body end nuts, using proper wrench size. Lift off body end. One seat should come out with body end.

Remove body seal.

To take out the ball, rotate stem so ball is in fully closed position. Lift ball from body, using a strap and lift device, if necessary.

NOTE: Extreme caution should be taken to avoid damage to the ball.

Take out other seat.

Stem must be removed from inside the body - a tap on the top of the stem should loosen it. The thrust washer should come out with the stem. Then remove the stem packing.

12.0 VISUAL INSPECTION

Clean and inspect metal parts. It is not necessary to replace the ball and stem unless the seating surfaces have been damaged by abrasion or corrosion. We strongly recommend replacement of all soft parts whenever the valve is disassembled for reconditioning to protect against subsequent leakage after valve reassembly.

NOTE: The valve may be assembled and operated dry where no lubricants are allowed in the system; however, a light lubrication of mating parts will aid in assembly and reduce initial operating torque. Lubricant used must be compatible with the intended line fluid.

13.0 ASSEMBLY

Install one seat in the body seat cavity with the spherical curvature facing the ball.

Install thrust washer on stem and slide the stem up through the body. Install packing and packing gland with packing gland bolt. Torque the packing gland nut with recommended values from **Table 1-4**, accordingly (page 11/12).

Install stop plate, handle and handle retainer nut.

Turn the handle CW to the CLOSED position. Line up the ball slot with the stem tang and slide the ball into position. For V-control valves, insert V-ball with V opening facing assembled seat in point 1. V cut in the ball should be on downstream side (body) seat following flow arrow marked on the body. Turn the handle CCW to the OPEN position to hold the ball in place.

Install the remaining seat into end cap seat pocket.

Put body seal gasket into shoulder counter bore at flange in valve body.

Put end cap back into body and line up end flange. Because the body flange bolt pattern is different from the line flange bolt pattern, it is possible to assemble the valve which the bolt holes in the line flanges don't line up. Be certain to align end flanges bolt holes to straddle valve center lines.

NOTE: Be careful not to damage body seal when assembling end into body.

Install body nuts and tighten in a crossing pattern to the torque specified in **Table 5**.

TABLE 5 - Body Nut Torque

Valve Size	Recommended Torque lb-in		Valve Size	Recommended Torque N m	
NPS	F15	F30	DN	F15	F30
1/2	140	140	15	16	16
3/4	140	140	20	16	16
1	210	210	25	24	24
1-1/2	550	550	40	62	62
2	550	550	50	62	62
2-1/2	550	550	65	62	62
3	550	1000	80	62	113
4	550	1000	100	62	113
6	1000	1000	150	113	113
8	1000	1450	200	113	164
10	1450	2400	250	164	271
12	1450	3600	300	164	407

GEKO SERIES GKV225/GKV225G 2 PIECE FLANGED FULL PORT BALL VALVES

Installation, Operation, and Maintenance Manual



Assembly - Continued



WARNING

Extreme care must be exercised during adjustment of body stud nuts to make sure that body studs are fully engaged. There should be at least one stud thread exposed beyond the flange on the bodyside and beyond the nut on the cap side.

Cycle the valve slowly, with a gentle back and forth motion, to build gradually to the full quarter turn. By cycling slowly, the seat lips will assume a permanent seal shape against the ball. A fast turning motion, at this point, may cut the seats before they have a chance to form the proper seal.

Test valve, if possible, prior to placing valve back into line position.



WARNING

If not properly secured, the valve can become separated from the pressure source, resulting in possible injury. Always join the valve to flanges of the same pressure rating and secure with a full set of flange bolts.

TEST AS FOLLOWS

1. Apply test flange to the valve with full set of flange bolts and a suitable gasket. Orient the valve with the bore in the vertical position and the seat being tested facing up
2. Introduce 50 to 100 psig air. Partially cycle the valve, under pressure, and then slowly close to make sure the cavity is pressurized (use hearing protection). Pour water into the upper port to cover the ball and visually check for bubbles. If bubbles appear, pour the water out, cycle the valve several times and recheck. To check for leakage in the other port, reverse the valve and introduce air pressure to the port just checked.
3. Check stem seal at this time by coating the gland area with a soapy water solution. If leakage occurs, tighten stem seal just until leakage stops.

14.0 RETURN MERCHANDISE AUTHORIZATION

All products that are returned require a Return Merchandise Authorization (RMA). Contact a Bray representative for instructions and RMA forms to be completed prior to return of any product.

The following information must be provided when submitting RMA.

- > Serial number
- > Part number
- > Month and year of manufacture
- > Actuator specifics
- > Application
- > Media
- > Operating temperature
- > Operating pressure
- > Total estimated cycles (since last installation or repair)

NOTE: Product information is provided on identification tag attached to device.



NOTICE

Materials must be cleaned and sanitized prior to return. MSDS sheets and Declaration of Decontamination are required.

SINCE 1956, GEKO HAS PROVIDED FLOW CONTROL SOLUTIONS FOR A VARIETY OF INDUSTRIES AROUND THE WORLD.

VISIT GEKO-UNION.COM TO LEARN MORE ABOUT GEKO PRODUCTS AND LOCATIONS NEAR YOU.

HEADQUARTERS

GEKO Fluid Contrl GmbH.
Schwalbenstr.28/2.
707994 Filderstadt
Germany
TEL: +49(0) 711 21570744

CHINA

**Geko Fluid Control
Technology (Changzhou)
Co., Ltd**
Add: Bldg. #11, No.67
Shunshan Road, Tianning
District, Changzhou,
China
TEL: +86 (519) 85503155

All statements, technical information, recommendations in this bulletin are for general use only. Consult Geko representatives or factory for the specific requirements and material selection for your intended application. The right to change or modify product design or product without prior notice is reserved. Patents issued and applied for worldwide. GEKO® is a registered trademark of Geko Valves&Controls

© 2023 GEKO VALVES&CONTROLS. ALL RIGHTS RESERVED. GEKO-UNION.COM

EN_GK_IOM_GKV225_GKV225G_2023-11-21

